



RXL

Room controller

RXL24.1

Communicating controller for chilled ceiling and radiator applications CC-02

The RXL24.1 room controller is used for temperature control in individual rooms.

- For chilled ceiling and radiator systems
- PI control
- Proprietary bus communication
- Integration into the DESIGO building automation and control system via PX KNX
- Integration into Synco
- Control of AC 24 V PDM¹⁾ thermic valve actuators or 3-position AC 24 V motorized valve actuators
- Commissioning with Synco ACS or "HandyTool"
- AC 24 V operating voltage
- Screw terminals

1) PDM = Pulse Duration Modulation

Application

The RXL24.1 room controller is optimized for control of chilled ceiling and radiator systems in individual rooms.

The application of each controller is determined by the application software.

The controllers are delivered with a fixed set of applications, each of which contains various individual applications. The relevant application is selected and activated during commissioning using one of the following tools:

- Syncro ACS
- "HandyTool" (the QAX34.3 room unit includes a tool function allowing you to parameterize the connected RXL controller).

No use of spare inputs/outputs

Unlike the RXB controllers, the RXL controllers do NOT support the use of spare inputs and outputs by the building automation and control system.

Functions

The room controller functions are determined by the selected application and its parameters, and by the input/output configuration.

For details, refer to the CLC and RAD description of functions, document CA110784.

When DESIGO RXL controllers are integrated into a building automation and control system, or into a Syncro system, additional functions become available such as time scheduling, central control of setpoints, etc.

Applications

The following applications are available for the RXL24.1 room controllers:

Application group (type)	Applications	
CC-02 (with RXL24.1)	CLC01	Chilled ceiling with dew point monitoring
	CLC02	Chilled ceiling with dew point monitoring, radiator with downdraft compensation
	RAD01	Radiator with downdraft compensation

Note Only one application at a time can be activated with the tool (Syncro ACS or "HandyTool").

Types

The RXL24.1 room controller has the following outputs:

Type	AC 24 V triac outputs
RXL24.1	For 2 thermic valve actuators or two 3-position actuators
RXZ20.1	Accessories: Terminal covers

Ordering

When ordering please specify the quantity, product name, type code and application group.

Example:

30 Room controllers, type RXL24.1/CC-02


Compatibility

The RXL24.1 room controller is compatible with field devices from Siemens Building Technologies.

For details, refer to the DESIGO RX hardware overview, CA2N3804.

Design

The RXL24.1 controller consists of a housing base, a housing cover and the printed circuit board with connection terminals. The controller also has a tool socket, a service LED and a programming pin.

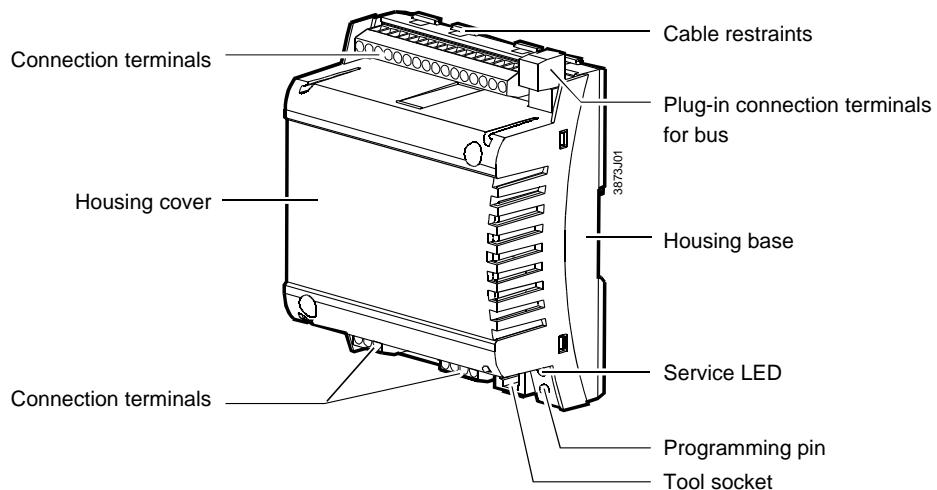

Service LED

The red / green service LED shows the operational status of the room controller as follows:

Green flashing	• OK, device is in operation
Red ON	• Addressing mode • Fault
Red flashing	• Fault
OFF	• No supply voltage • Fault • Service LED disabled by software

Programming pin


The programming pin is used to identify the controller in the commissioning phase.

Pressing this pin causes the red programming LED to light up and remain on until identification of the controller is complete.

Once the programming pin has been pressed, the tool overwrites the hardware address in the room controller.


Terminal cover

Terminal covers (RXZ20.1) are available as an option, to protect the connection terminals from physical contact and dirt. The service LED remains visible when the terminal covers are in place, and the programming pin can be operated with a pointed implement. The cable is connected to the room controller by breaking out the perforated cable entry guide.

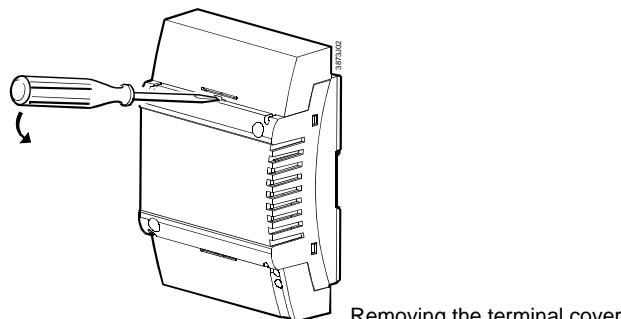

Removing the terminal cover

Label

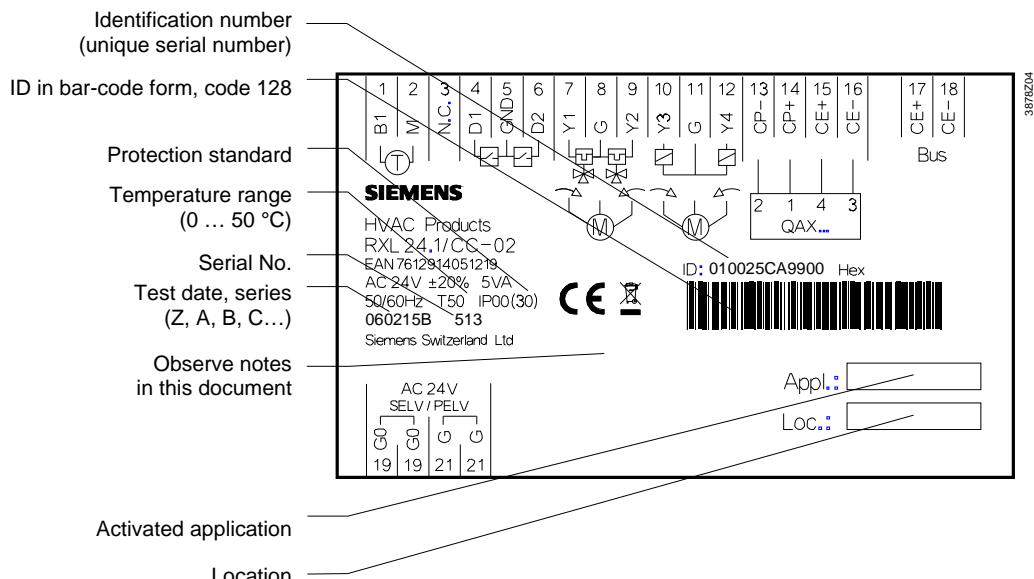

Note

Options for use of the labeling fields "Appl." and "Loc.":
Handwritten identification of the location and the activated application group.

Connection terminals

The connection terminals for the bus are detachable plug-in screw-terminals. All other terminals are fixed..

Communication


The RXL24.1 controller communicates with other devices via the following interfaces:

- PPS2 interface (proprietary) for the exchange of data with the room units
- Bus (terminals CE+ and CE-) for communication with:
 - PX/KNX interface (to DESIGO INSIGHT)
 - Interface OCI700 (to Syncro)
 - Other DESIGO RXL controllers

Connecting the tool

To facilitate commissioning, the Syncro ACS tool can be connected at three different points (marked **(A)** in the diagram) in the plant:

- to the bus cable at any point
- to the RXL2... controller (RJ45 tool socket)
- to the room unit (RJ45 tool socket)

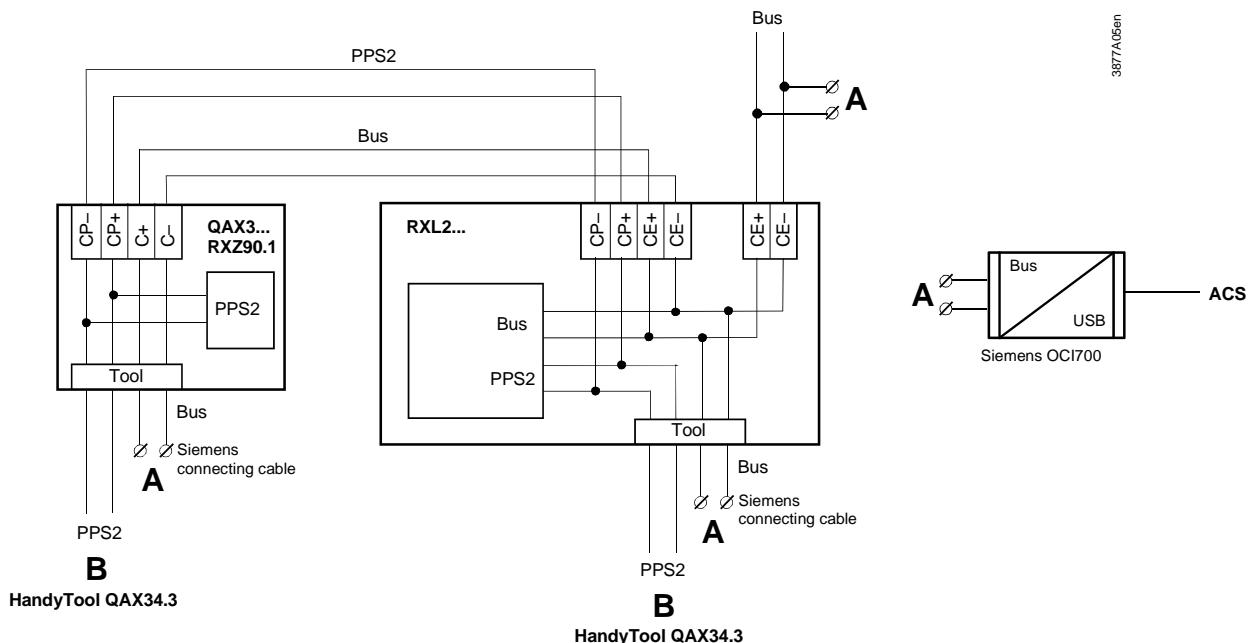

Notes

- The tool socket is a proprietary socket.

A Siemens connecting cable must be used (e.g. PXA-C1).

When connected to Ethernet, the device on the other end may be damaged!



Caution!

- The ACS tool, even if connected to a tool socket, requires an interface (OCI700).
- The "HandyTool" is connected to the tool socket of the room controller or to the tool socket of the room unit (QAX3..., RXZ90.1) (**B**).
- If you use OCI700 as an interface, it is connected to the service plug of the controller or of the room unit.

As long as the OCI700 is connected to the service plug, it must be supplied by the computer via the USB interface. Otherwise the LCD display of the room unit will turn dark and the controller will switch to addressing mode.

Disposal



The device includes electrical and electronic components and must not be disposed of as domestic waste.

Current local legislation must be observed.

Engineering notes

Bus	Topology	Line or star NO closed loops
	Cable length	Max. 1000 m
	Cable length	E.g. YCYM 2 x 2 x 0.8 mm
	Number of RXL Controllers per Network	Max. 45
	Bus supply	Up to 45 RXL-controllers: ACX95.320/ALG or 5WG1 125-1AB11
	Bus terminator	Not required

AC 24 V supply cables

- The RXL2... room controllers operate with a supply voltage of AC 24 V.
- The controlled devices (damper actuators) receive their power directly from the room controller. This means that a separate AC 24 V supply is not necessary for the field devices.
- The sizing and fuse protection of the power supply cables depends on the total load and on local regulations.

AC 24 V triac outputs

The **simultaneous** load on outputs Y1 ... Y4 must not exceed 9.5 VA.

Example:



Y1 (heating)	2 thermic valve actuators, type STA72E	5 W
Y2 (cooling)	2 thermic valve actuators, type STA72E	5 W

The maximum load is 9.5 VA for the heating sequence and 9.5 VA for the cooling sequence.

This is acceptable because the two sequences never operate at the same time.

Mounting instructions

The room controllers can be mounted in any orientation, and fixed as follows:

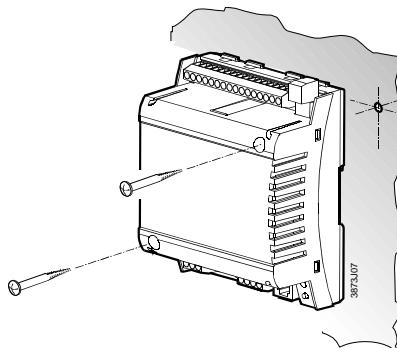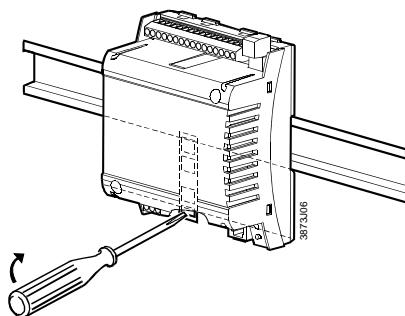

Rail mounting

The housing base is designed for snap-mounting on DIN rails, type EN50022-35 x 7.5 (can be released with a screwdriver).

Surface mounting

There are two drill holes for screw-mounting (see "Dimensions" for drilling template). The housing base is fitted with raised supports.

Screws: Max. diameter 3.5 mm, min. length 38 mm



Note!

Tightening torque for fixing screws max. 1.5 Nm

When mounting note the following:

- The controller should not be freely accessible after mounting. It must be mounted in a cabinet or behind a cover that can only be opened / removed with a key or a tool.
- Ensure adequate air circulation to dissipate heat generated during operation.
- Easy access is required for service personnel
- Local installation regulations must be observed.

Mounting instructions and a drilling template are printed on the controller packaging.

Commissioning

The RXL24.1 room controller is commissioned with one of the following tools:

- Synco ACS via the OCI700 interface
- "HandyTool" via PPS2.

Labeling

The definitive application and the controller's location are handwritten in the labeling fields "Appl." and "Loc" in the commissioning stage.

Function test

A special test mode (HandyTool) is available for operation of the outputs and interrogation of the inputs.


Technical data

⚠ Power supply	Operating voltage Frequency Power consumption with connected field devices Internal fuse	AC 24 V ± 20 % (SELV, PELV) 50/60 Hz Max. 15 VA None
Operating data	Control algorithm	PI
Inputs		
Signal inputs D1, D2 (for volt-free contacts)	Quantity Contact voltage Contact current Contact transfer resistance Contact insulation resistance Switch time:	2 DC 16 V DC 5 mA Max. 100 Ω Min. 50 kΩ min. 20ms "ON", min. 20ms "OFF"
Measured value input B1	Compatible temperature sensors Quantity measuring range Sensor current Resolution <u>Measuring error at 25 °C sensor temp. (without cable)</u>	LG-Ni 1000 1 0 ... 50 °C 0.5 mA 0.1 K max. 0.5 K
Outputs		
AC24 V triac outputs , Y1 ... Y4	Quantity Output voltage (equal to supply voltage) Output current Total nominal load (at both outputs simultaneously)	4 AC 24 V ON/OFF, PWM or 3-position Max. 0.5 A Max. 9.5 VA (e.g. 2 thermic valve actuators STA72E per heating and cooling sequence
Ports/interfaces		
Interface to room unit	Number of room units connectable Interface type for room unit for ACS	1 PPS2 Bus
	PPS2 baud rate <u>Baud rate on bus</u>	4.8 kbit/s 9.6 kbit/s
Bus	Interface type Bus current Baud rate <u>Bus topology</u>	Electrically isolated 5 mA 9.6 kbit/s Refer to "engineering", page 6
Cable connections		
	Connection terminals for signals and power supply Bus connection terminals (plug-in screw terminals) Single cable lengths	Solid or stranded conductors 0.25 ... 2.5 mm ² or 2 x 1.5 mm ² Solid or stranded conductors 2 x max.1.0 mm ² e.g. YCYM 2x2x0.8 For field devices, see also the RXC installation guide, CA110334
	Signal inputs D1, D2 Measured value input B1 AC24 V triac outputs , Y1 ... Y4 Interface to room unit	Max. 100 m with diameters ≥ 0.6 mm Max. 100 m Max. 100m where A ≥ 1.5 mm ² Max. 115 m where A= 0.75 mm ² (including connecting cable for tool)
	Cable type Bus Tool connecting cable	4-core, twisted pair, unscreened Max. 500 m, see "engineering", page 6 Max. 3 m

Housing protection standard	Protection standard to EN 60529	IP30 with terminal cover fitted and wall mounted without DIN rail IP00 for all other mounting arrangements
Protection class	Suitable for use in systems with protection class I or II	
Ambient conditions	Normal operation Temperature Humidity	Class 3K5 to IEC 60721-3-3 0 ... 50 °C < 85 % rh
	Transport Temperature Humidity	Class 2K3 to IEC 60721-3-2 – 25 ... 65 °C < 95 % rh
Industry standards	Product safety Automatic electronic controls for household and similar use Special requirements for energy regulators	EN 60730-1 EN 60730-2-11
	Electromagnetic compatibility Interference immunity in industrial environment Emitted interference in domestic environment	EN 61000-6-2 EN 61000-6-3
	CE marking: EMC Directive Low Voltage Directive Home and Building Electronic Systems (HBES)	89/336/EEC 2006/95/EEC EN 50090-2-2
Dimensions	See dimension diagrams	
Weight	excluding packaging	0.250 kg
	including packaging	0.380 kg

Connection terminals

RXL24.1

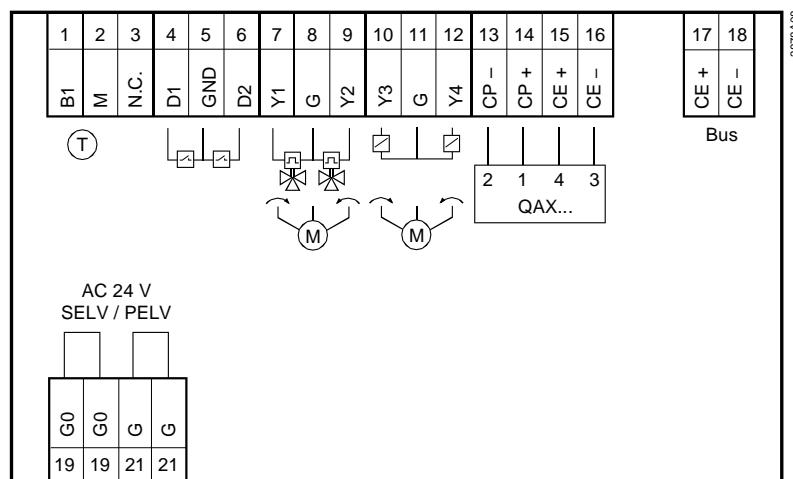

Measured value input

B1 1 Measured value input for LG-Ni 1000 sensors
M 2 Measured value input ground

Signal inputs

D1 4 Signal input
GND 5 Signal ground
D2 6 Signal input

Triac outputs

Y1 7 AC 24 V, 0.5 A switching output
G 8 AC 24 V actuator supply
Y2 9 AC 24 V, 0.5 A switching output
Y3 10 AC 24 V, 0.5 A switching output
G 11 AC 24 V actuator supply
Y4 12 AC 24 V, 0.5 A switching output

Room unit

CP- 13 PPS2 ground
CP+ 14 PPS2 data
CE+ 15 Bus
CE- 16 Bus

Bus (plug-in connection)

CE+ 17 Bus
CE- 18 Bus

Power supply


G0 19 Controller ground
G 21 AC 24 V +/- 20 %

Caution

- Local installation regulations must be observed.

Tool socket


Proprietary RJ45-type tool socket



1	Bus (CE+)	5	+12VDC
2	Bus (CE-)	6	RxD
3	Not used	7	PPS2 (CP+) / TxD
4	Not used	8	PPS2 (CP-)

Connection diagrams

Connection of field devices, room unit, bus and power supply

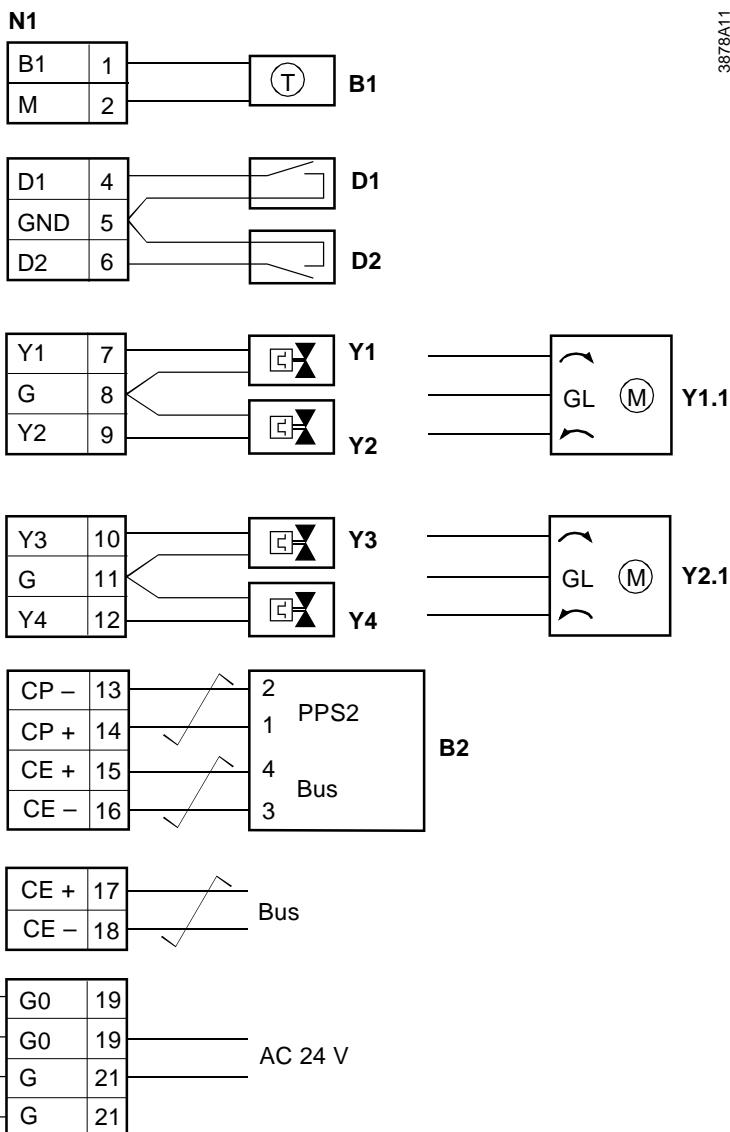

3878A11

- N1 RXL24.1
 B1 LG-Ni 1000 temperature sensor
 D1, D2 Volt-free contacts (window contact, occupancy sensor, etc.)
 Y1...Y4 AC 24 V thermic valve actuators
 Y1.1 Motorized AC 24 V, 3-position valve actuator
 Y2.1 Motorized AC 24 V, 3-position valve actuator
 B2 QAX3... room unit

↙ Twisted pair

- Note For information on the compatibility of field devices with the RXL24.1 room controller, refer to the various application descriptions (see the CLC and RAD description of functions, document CA110784)

Parallel connection of several thermic valve actuators

Up to two thermic actuators per sequence may be connected directly to the room controller. With more than two thermic actuators, a UA1T power amplifier is required.

The principle is the same for output Y2. Do not exceed the maximum simultaneous load on outputs Y1 and Y2 (max. 9.5 VA).

Power consumption at input X1 of the UA1T: 0.5 VA.




Note!


Mixed operation: It is not permissible to connect thermic actuators both to the controller and to the power amplifier.

Owing to the difference in voltage between the controller's internal transformer and the power supply of the UA1T, this could cause the valve positions to deviate substantially.

Connection to the controller

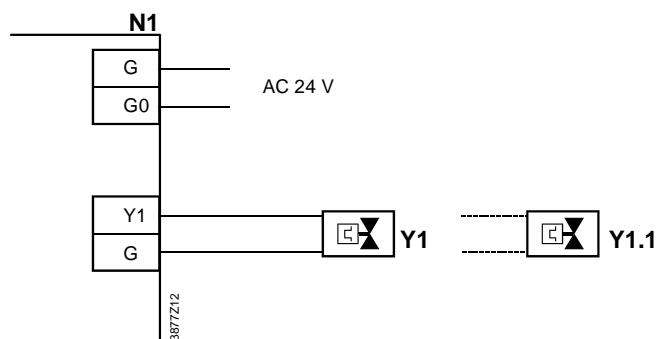

Connection to the power amplifier

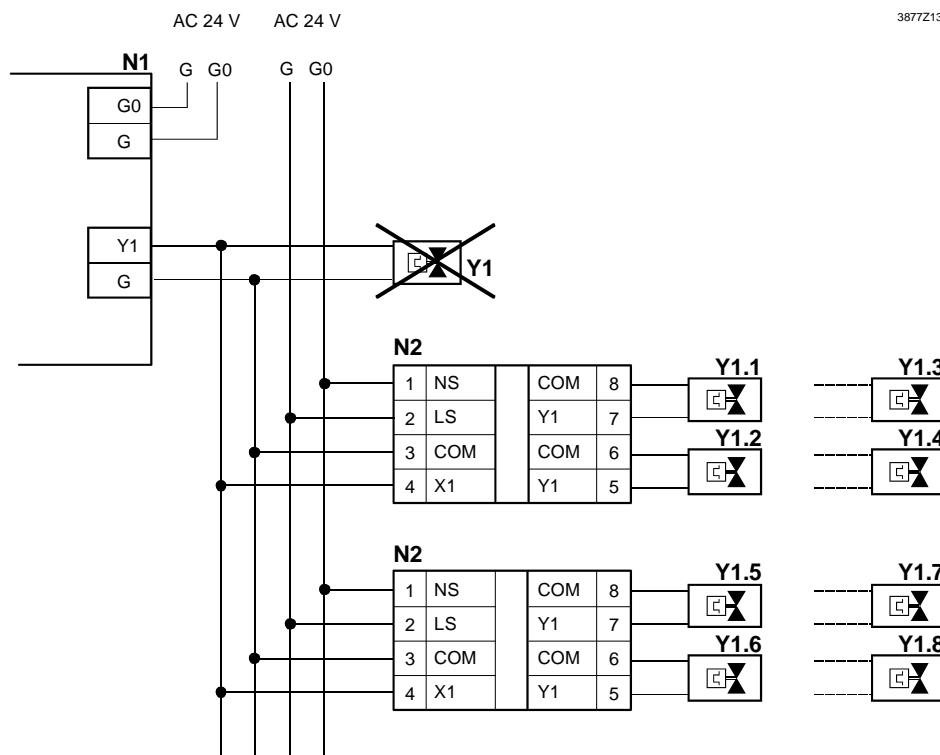

N1 Room controller RXL24.1

N2 UA1T power amplifier (see data sheet CA2N3591)

Y1 AC 24 V thermic valve actuators connected to the controller

Y1.x AC 24 V thermic valve actuators

(max. 2 STA71/STP71 actuators per Y1 output on the UA1T)


Notes

- The UA1T requires an AC 24 V supply voltage
- The UA1T is *not* suitable for the connection of 3-position actuators.


Dimensions

Dimensions in mm

Without terminal cover

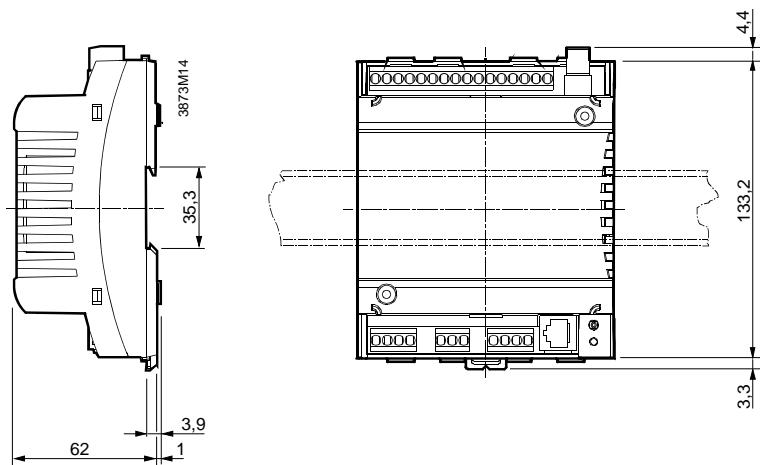

With terminal covers

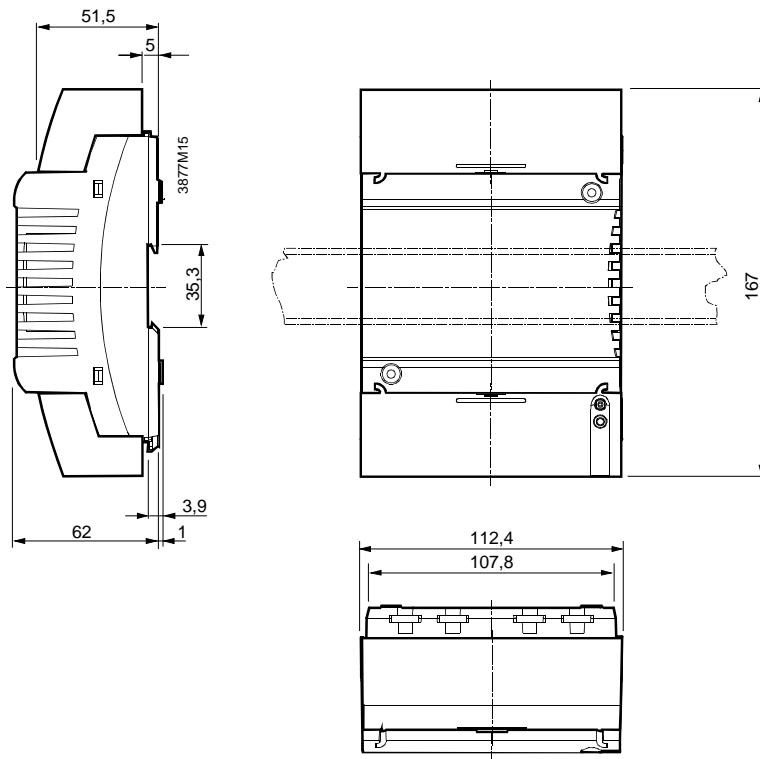

Drilling diagram (1:1)

